SDWK41 Star Delta Wiring Kit

SDWK41 Star Delta Wiring Kit

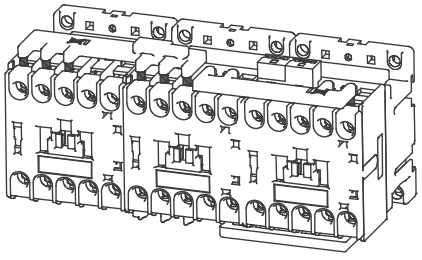

NOARK

WARNING

DO NOT ATTEMPT TO INSTALL OR PERFORM MAINTENANCE ON EQUIPMENT WHILE IT IS ENERGIZED.DEATH,SEVERE PERSONAL INJURY,OR SUBSTANTIAL PROPERTY DAMAGE CAN RESULT FROM CONTACT WITH ENERGIZEDE QUIPMENT.

ALWAYS VERIFY THAT NO VOLTAGE IS PRESENT BEFORE PROCEEDING WITH THE TASK,AND ALWAYS FOLLOW GENERALLY ACCEPTED SAFETY PROCEDURES.

NOARK IS NOT LIABLE FOR THE MISAPPLICATION OR MISINSTALLATION OF ITS PRODUCTS.

A

1. Main Parallel Bar(MPB)

2. Control Parallel Bar(CPB)

3. Short Circuit Bar(SCB)

4. Reversing Bar(RB)

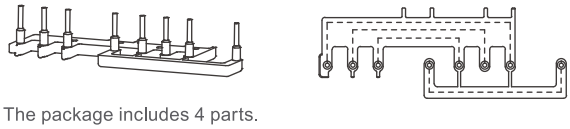

The package includes 4 parts.

Notes

The instructions for installation,testing,maintenance,or repair herein are provided for the use of the product in general commercial applications and may not be appropriate for use in nuclear applications.Additional instructions may be available upon specific request to replace,amend,or supplement these instructions to qualify them for use with the product in safety-related applications in a nuclear facility.

This Instruction Booklet is published solely for information purposes and should not be considered all-inclusive.If further information is required,you should consult an authorized NOARK sales representative.

The sale of the product shown in this literature is subject to the terms and conditions outlined in appropriate NOARK selling policies or other contractual agreement between the parties.This literature is not intended to and does not enlarge or add to any such contact.The sole source governing the rights and remedies of and purchaser of this equipment is the contract between the purchaser and NOARK.

NO WARRANTIES,EXPRESSED OR IMPLIED,INCLUDING WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE OR MERCHANTABILITY,OR WARRANTIES ARISING FROM COURSE OF DEALING OR USAGE OF TRADE,ARE MADE REGARDING THE INFORMATION,RECOMMENDATIONS,AND DESCRIPTIONS CONTAINED HEREIN.

In no event will NOARK be responsible to the purchaser or user in contact in tort (including negligence),strict liability or otherwise for any special indirect incidental or consequential damage or loss whatsoever including but not limited to damage or loss of use of equipment plant or power system cost of capital loss of power additional expenses in the use of existing power facilities or claims against the purchaser or user by its customers resulting from the use of the information recommendations and description contained herein.

B

loose the terminal screws

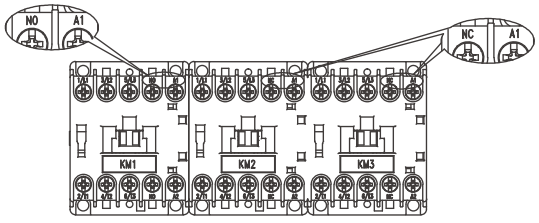

Ex9CS Ex9CSR*

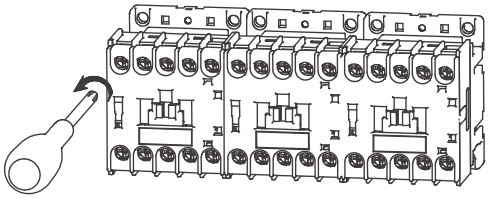

*Ex9CSR is a reversing contactor combination consisting a built-in mechanical interlock.

C

Insert the parts into the contactor terminals as illustrated below, the CPB is optional for control circuit

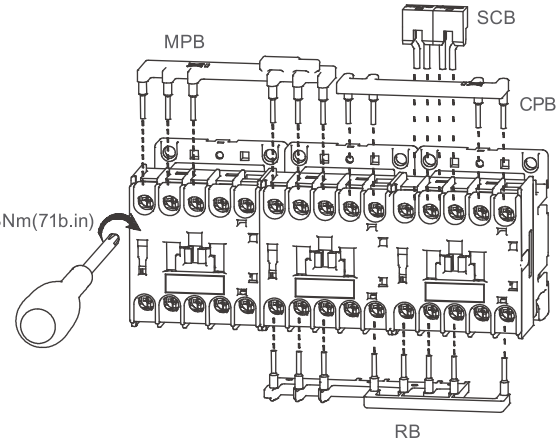

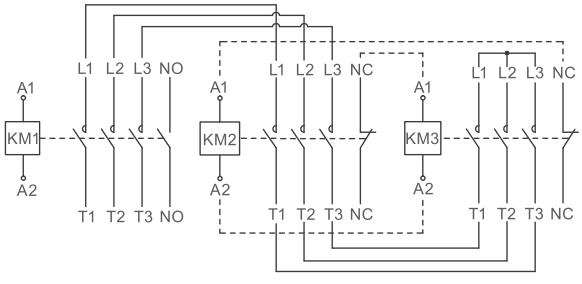

D

Now,SDWK41 mounted onto the contactors for Star Delta Motor starting is finished

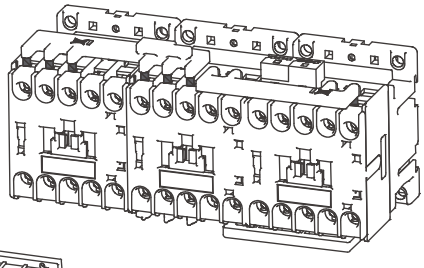

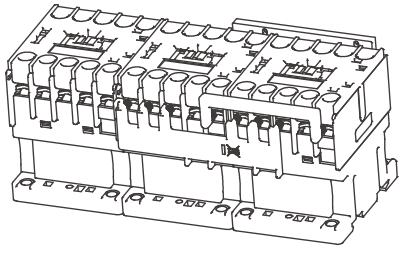

Copyright Noark. All Rights Reserved

na.NOARK-Electric.com

ZSDWK41201908UL